

# Heatcraft Coil Certified Drawing

## CLEANABLE FLUID CP 1070-F

Customer \_\_\_\_\_ Customer P.O. Number \_\_\_\_\_

Job \_\_\_\_\_

Written by \_\_\_\_\_ Date \_\_\_\_\_

Approved by \_\_\_\_\_ Date \_\_\_\_\_


#	TAG	QTY	MODEL NUMBER					HAND Left Right
			TYPE	FPI	ROWS DEEP	FIN	FH	
1								
2								
3								
4								

GENERAL OPTIONS	
<input type="checkbox"/>	Label Kit
<input type="checkbox"/>	Mounting Holes
<input type="checkbox"/>	Corrosion Resistant Coating

MATERIALS OF CONSTRUCTION	
FINS	AL CU CS St Stl
Fin Thick	
TUBES	CU CuNi CS St Stl
Tube Size	
HEADERS	CU CuNi CS St Stl
CONN	CS Cu Sweat Red Brass St Stl
CASING	AL CU Galv Stl St Stl

#	DIMENSIONAL DATA												
	CONNECTION							FLANGES			W	FIG#	
	SIZE	A	E	H	J	L	M	R	S	T			
1													
2													
3													
4													

REMARKS:

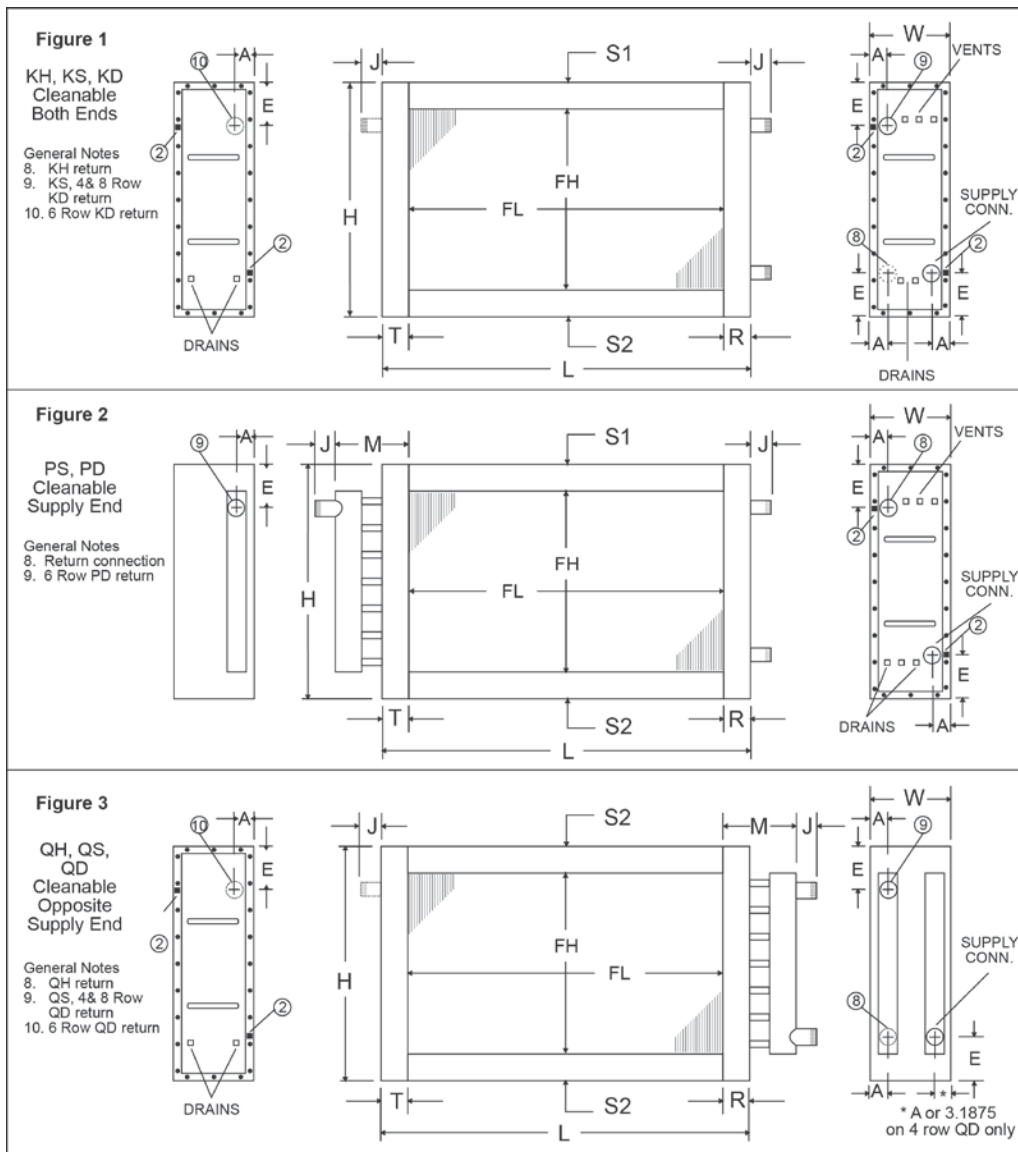

### GENERAL NOTES

1. Mounting holes are optional. 0.375" diameter holes on 6" centers from the centerline of the fin height and finned length are typical for all flanges. Not available when  $S < 1"$ .
2. Jackscrews are provided to facilitate head removal.
3. All dimensions are in inches.
4. The supply line should be connected to the lower connection on the leaving air side for counterflow operation.
5. 1" wide reinforcement bars may extend past flanges.
6. Phenolic coated coils require a longer lead-time since they must be re-tested after coating.
7. Intermediate tube supports are fabricated from heavy gauge stock and supplied per the chart to the below.

Finned Length (FL)	Tube Supports
$\leq 48$	0
$> 48 \leq 96$	1
$> 96 \leq 144$	2
$> 144$	4