

Heatcraft Coil Certified Drawing

CLEANABLE FLUID CP 1070-F






Customer _____ Customer P.O. Number _____
 Job _____
 Written by _____ Date _____
 Approved by _____ Date _____

| # | TAG | QTY | MODEL NUMBER | | | | | | HAND Left Right |
|---|-----|-----|--------------|-----|--------------|-----|----|----|-----------------------|
| | | | TYPE | FPI | ROWS DEEP | FIN | FH | FL | |
| 1 | | | | | | | | | |
| 2 | | | | | | | | | |
| 3 | | | | | | | | | |
| 4 | | | | | | | | | |

| # | DIMENSIONAL DATA | | | | | | | | | | FIG# |
|------|------------------|---|---|---------|---|---|---|---|---|---|------|
| | CONNECTION | | | FLANGES | | | | | | | |
| SIZE | A | E | H | J | L | M | R | S | T | W | FIG# |
| 1 | | | | | | | | | | | |
| 2 | | | | | | | | | | | |
| 3 | | | | | | | | | | | |
| 4 | | | | | | | | | | | |

REMARKS:

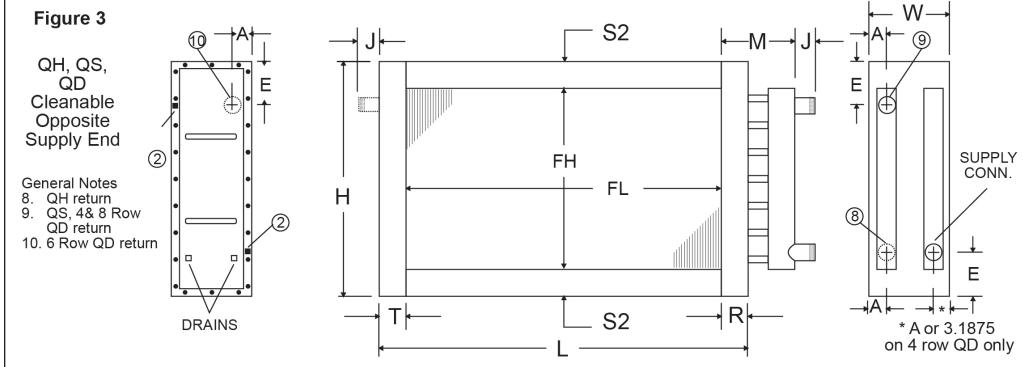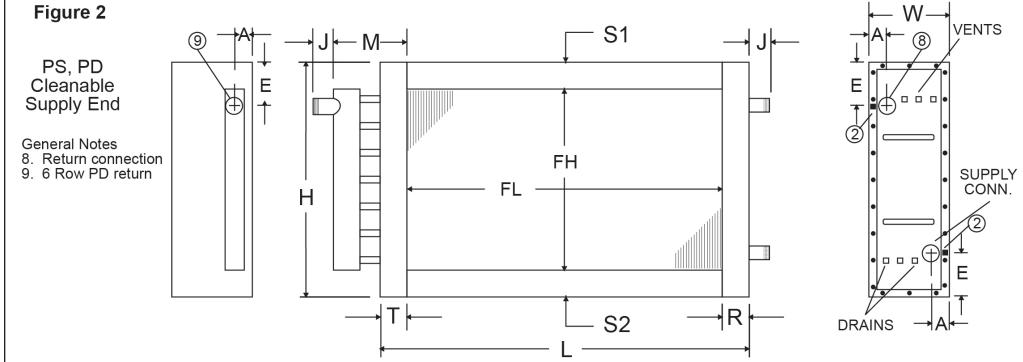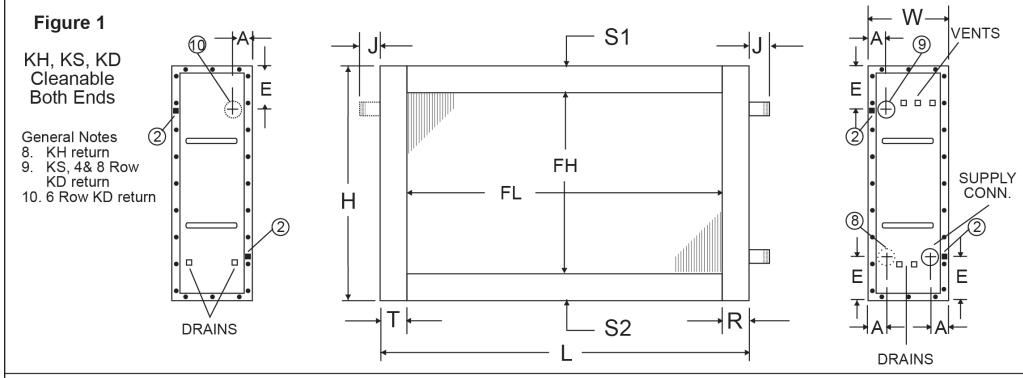

GENERAL NOTES

- Mounting holes are optional. 0.375" diameter holes on 6" centers from the centerline of the fin height and finned length are typical for all flanges. Not available when S < 1".
- Jackscrews are provided to facilitate head removal.
- All dimensions are in inches.
- The supply line should be connected to the lower connection on the leaving air side for counterflow operation.
- 1" wide reinforcement bars may extend past flanges.
- Phenolic coated coils require a longer lead-time since they must be re-tested after coating.
- Intermediate tube supports are fabricated from heavy gauge stock and supplied per the chart to the below.

| Finned Length (FL) | Tube Supports |
|-----------------------|------------------|
| ≤ 48 | 0 |
| > 48 ≤ 96 | 1 |
| > 96 ≤ 144 | 2 |
| > 144 | 4 |